

- GENERAL NOTES:**
1. REFER TO APPLICABLE FORTIFIED HOME STANDARDS FOR ADDITIONAL INFORMATION.
 2. FORTIFIED HOME STANDARDS ARE TO BE APPLIED IN CONJUNCTION WITH FEDERAL, STATE, AND LOCAL CODES, ORDINANCES AND REGULATIONS IN ADDITION TO THE STRUCTURAL DESIGN WHICH IS BY OTHERS. IN CASE OF A CONFLICT BETWEEN PROVISIONS, USE WHICHEVER IS MORE STRINGENT.
 3. FOR PREVIOUSLY FORTIFIED DESIGNATED HOMES WITH ULTIMATE SITE DESIGN WIND SPEED OF 160 MPH OR LESS IN EXPOSURE B OR C LOCATIONS, SUPPLEMENTAL FASTENING IS NOT REQUIRED.

○ EXISTING FASTENERS; IF IT CAN BE DOCUMENTED THAT EXISTING NAILING MEETS THE REQUIREMENTS OF F-RS-2, THEN SUPPLEMENTAL FASTENING (+) IS NOT REQUIRED.

+ RENAIL ROOF DECK WITH ADDITIONAL 0.113" X 2-3/8" 8D RING SHANK NAILS @ = 4" O.C. (SPACING BETWEEN NEW AND EXISTING NAILS SHALL NOT BE LESS THAN 2 INCHES.)

KEY:
 ○ = EXISTING FASTENERS
 + = ADDITIONAL FASTENERS
 A = SPACING OF ADDITIONAL FASTENERS
 B = SPACING BETWEEN EXISTING AND ADDITIONAL FASTENER

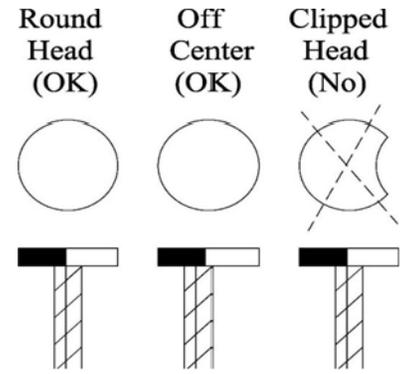
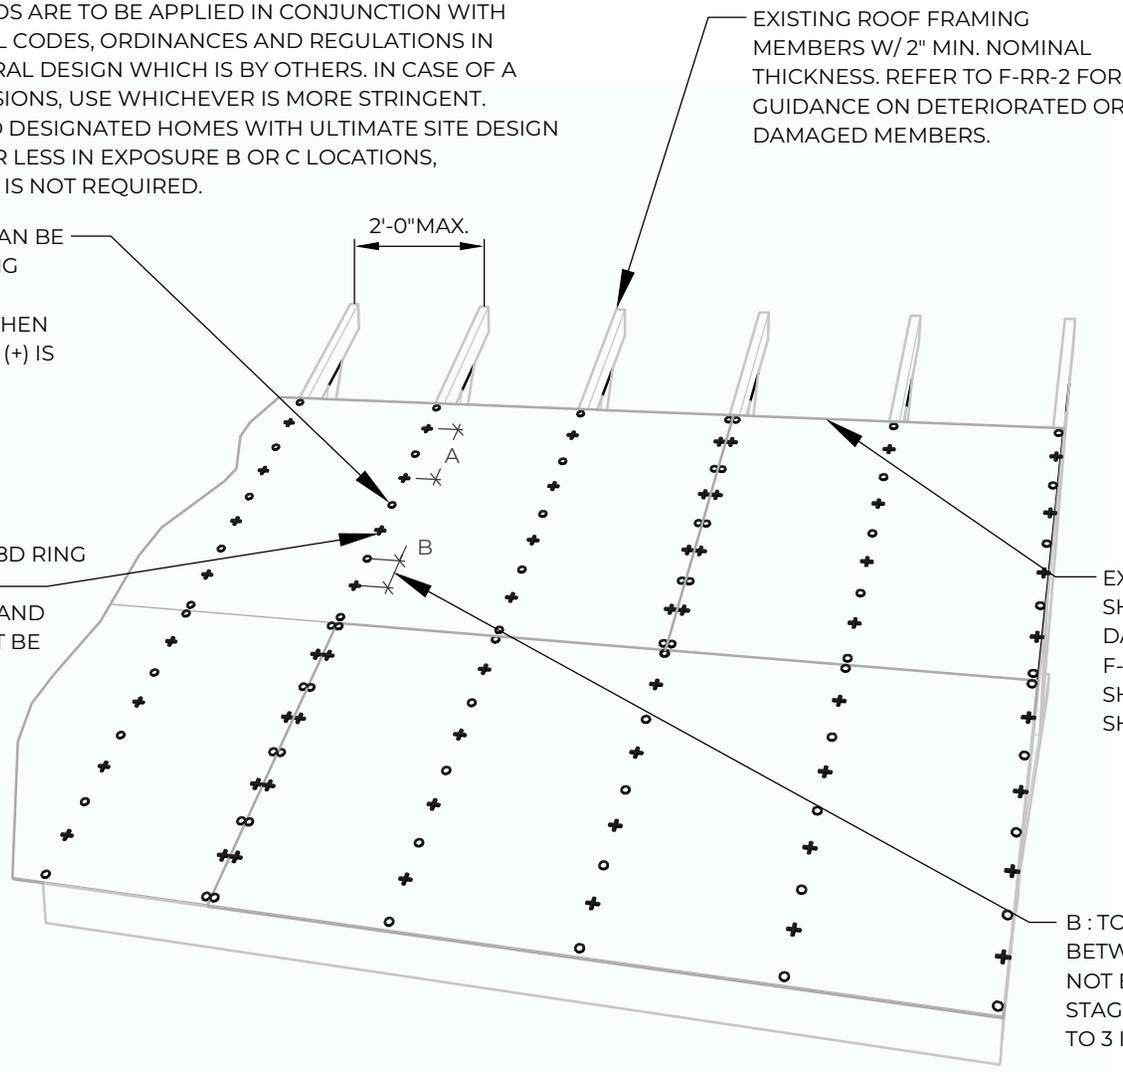


FIGURE 1.

EXISTING STRUCTURAL WOOD PANEL ROOF SHEATHING (PLYWOOD OR OSB) W/ NO DAMAGE OR DETERIORATION. REFER TO F-RR-1 FOR DAMAGED OR DETERIORATED SHEATHING. REFER TO F-RS-2 FOR SHEATHING THICKNESS REQUIREMENTS.

B : TO AVOID WOOD SPLITTING, SPACING BETWEEN NEW AND EXISTING NAILS "B" SHALL NOT BE LESS THAN 2 IN. NAILS SHALL BE STAGGERED WHEN "B" IS LESS THAN OR EQUAL TO 3 IN.

	APPLICABLE STANDARDS:	DESCRIPTION:	DRAWING #:
	FORTIFIED HOME™ - HURRICANE (2025) FORTIFIED HOME™ - HIGH WIND (2025)	HURRICANE AND HIGH WIND - RE-NAILING THE ROOF DECK (WOOD STRUCTURAL PANELS)	F-RR-3
			DATE: 11/01/2024