

GENERAL NOTES:

1. REFER TO APPLICABLE FORTIFIED HOME STANDARDS FOR ADDITIONAL INFORMATION.
2. REFER TO F-RS-3 FOR MINIMUM SHEATHING THICKNESS REQUIREMENTS.
3. FORTIFIED HOME STANDARDS ARE TO BE APPLIED IN CONJUNCTION WITH FEDERAL, STATE, AND LOCAL CODES, ORDINANCES AND REGULATIONS IN ADDITION TO THE STRUCTURAL DESIGN WHICH IS BY OTHERS. IN CASE OF A CONFLICT BETWEEN PROVISIONS, USE WHICHEVER IS MORE STRINGENT.

EXISTING ROOF FRAMING MEMBERS W/ 2" MIN. NOMINAL THICKNESS. REFER TO F-RR-2 FOR GUIDANCE ON DETERIORATED OR DAMAGED MEMBERS.


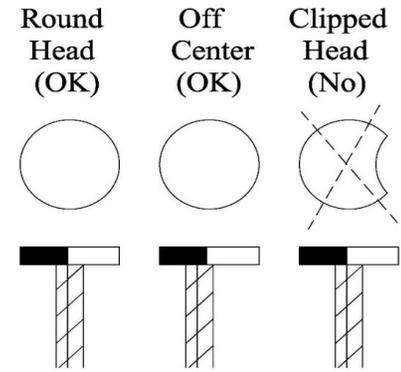


FIGURE 1.

○ EXISTING FASTENERS; IF IT CAN BE DOCUMENTED THAT EXISTING NAILING MEETS THE REQUIREMENTS OF F-RS-3, THEN SUPPLEMENTAL FASTENING (+) IS NOT REQUIRED.

✚ ADDITIONAL 0.113" X 2-3/8" 8D RING SHANK NAILS @ = 6" O.C.

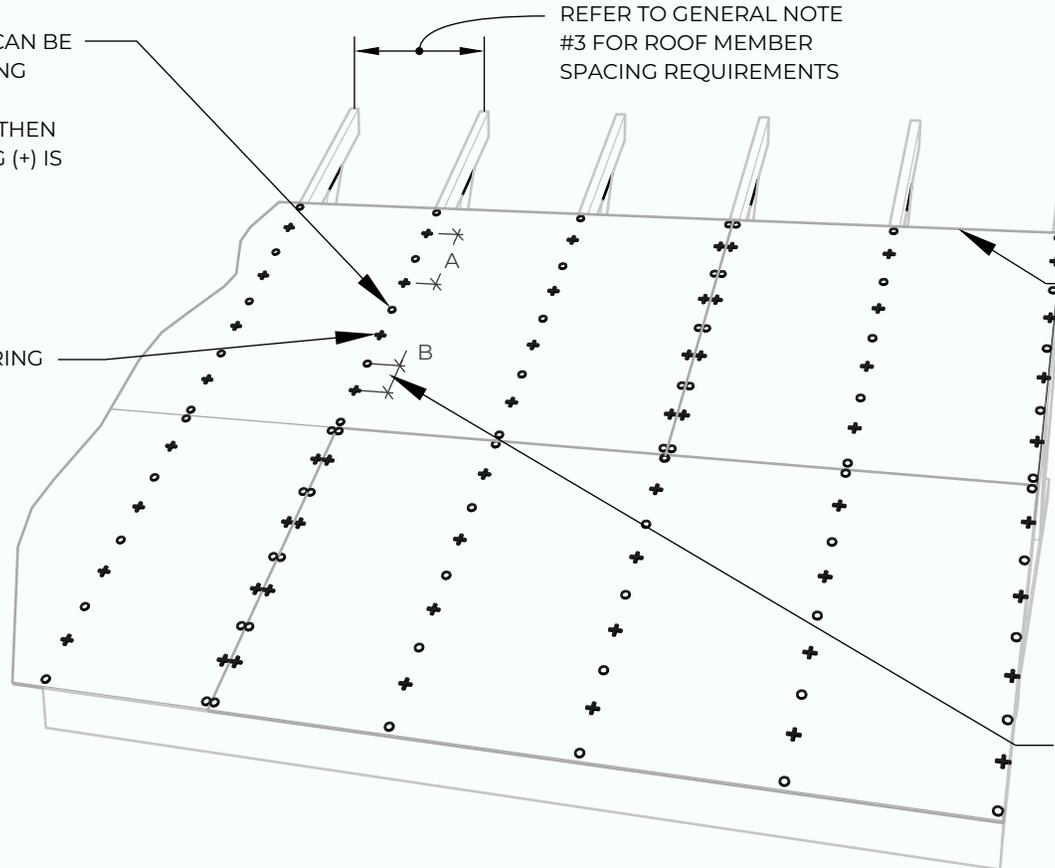

REFER TO GENERAL NOTE #3 FOR ROOF MEMBER SPACING REQUIREMENTS

EXISTING STRUCTURAL WOOD PANEL ROOF SHEATHING (PLYWOOD OR OSB) BY OTHERS W/ NO DAMAGE OR DETERIORATION. REFER TO F-RR-1 FOR DAMAGED OR DETERIORATED SHEATHING. REFER TO F-RS-3 FOR SHEATHING THICKNESS REQUIREMENTS.

B: TO AVOID WOOD SPLITTING, SPACING BETWEEN NEW AND EXISTING NAILS "B" SHALL NOT BE LESS THAN 2 IN. NAILS SHALL BE STAGGERED WHEN "B" IS LESS THAN OR EQUAL TO 3 IN.

KEY:

- = EXISTING FASTENERS
- ✚ = ADDITIONAL FASTENERS
- A = SPACING OF ADDITIONAL FASTENERS
- B = SPACING BETWEEN EXISTING AND ADDITIONAL FASTENER



APPLICABLE STANDARDS:
FORTIFIED HOME™ - HIGH WIND (2020)

DESCRIPTION:

HIGH WIND - RE-NAILING THE ROOF DECK (WOOD STRUCTURAL PANELS)

DRAWING #:

F-RR-4

DATE:

11/01/2020