

**GENERAL NOTES:**


1. REFER TO APPLICABLE FORTIFIED HOME STANDARDS FOR ADDITIONAL INFORMATION.
2. APPLICABLE FOR SHINGLE OR METAL ROOF COVERS.
3. FORTIFIED HOME STANDARDS ARE TO BE APPLIED IN CONJUNCTION WITH FEDERAL, STATE, AND LOCAL CODES, ORDINANCES AND REGULATIONS IN ADDITION TO THE STRUCTURAL DESIGN WHICH IS BY OTHERS. IN CASE OF A CONFLICT BETWEEN PROVISIONS, USE WHICHEVER IS MORE STRINGENT.
4. FOR **RE-ROOFING**, EXISTING NAILING MUST BE DOCUMENTED TO MEET TABLE F-RS-1 OR BOARDS MUST BE RE-NAILED PER TABLE F-RS-1. FOR **NEW CONSTRUCTION**, NAILING MUST MEET TABLE F-RS-1. RING SHANK NAILS OR SMOOTH SHANK NAILS WITH EQUAL DIAMETER AND EMBEDMENT ARE ACCEPTABLE.

REFER TO TABLE F-RS-1 FOR REQUIRED SIZE AND NUMBER OF NAILS.

FOR GAPS GREATER THAN 1/8" BETWEEN BOARDS, REFER TO F-RR-5

BOARD WIDTH

24" O.C. MAX.

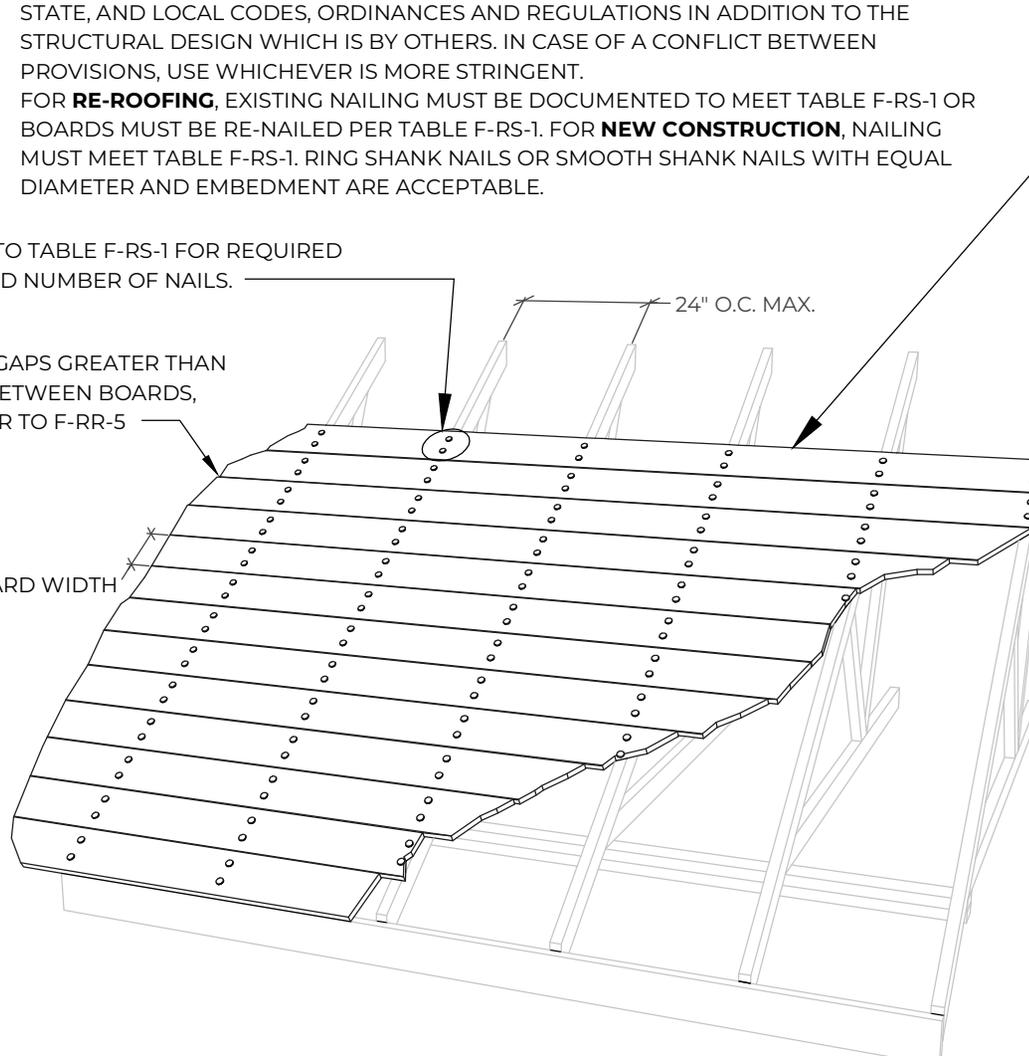

**Table F-RS-1: FASTENERS REQUIRED FOR WOOD BOARD DECKING ATTACHMENT.**

WOOD BOARD/LUMBER (ROOF DECKING) WIDTH	NUMBER AND MINIMUM DIMENSIONS OF NAILS PER BOARD FOR EACH FRAMING MEMBER IT CROSSES
<b>UP TO 8".</b>	TWO(2) 0.131" Ø MIN. W/ 1 - 5/8" PENETRATION INTO ROOF FRAMING MEMBERS (MIN. LENGTH OF NAIL= 2 - 1/2")
<b>LARGER THAN 8".</b>	THREE(3) 0.131" Ø MIN. W/ 1 - 5/8" PENETRATION INTO ROOF FRAMING MEMBERS (MIN. LENGTH OF NAIL= 2 - 1/2")

NOTE: CLIPPED-HEAD, D-HEAD, OR ROUND-HEAD NAILS SHALL BE ACCEPTABLE PROVIDED THEY HAVE THE REQUIRED MINIMUM DIAMETER AND LENGTH .



**APPLICABLE STANDARDS:**

FORTIFIED HOME™ - HURRICANE (2025)  
 FORTIFIED HOME™ - HIGH WIND (2025)

**DESCRIPTION:**

ROOF DECK ATTACHMENT - SAWN LUMBER OR WOOD BOARD ROOF DECK WITH NO GAPS

**DRAWING #:**

F-RS-1

**DATE:**

11/01/2024